

Simulation of ATLAS SGTR-HL-04 Experiment using SPACE Code

Dong-Hyuk Lee^{a*}, Sang-Jun Ha^a, Seyun Kim^a

^aNuclear Reactor Safety Laboratory, KHNP Central Research Institute, KHNP
70,1312-gil Yusung-daero, Yusung-gu, Daejeon, Korea

*Corresponding author: dhlee7@khnp.co.kr

1. Introduction

The Korean nuclear industry has been developing a thermal-hydraulic analysis code for the safety analysis of PWRs (pressurized water reactors). The new code is named SPACE (Safety and Performance Analysis Code for Nuclear Power Plant). As a part of code validation effort, simulation of ATLAS SGTR (Steam Generator Tube Rupture) experiment using SPACE code has been performed. The SGTR-HL-04 experiment is a single U-tube SGTR. The calculated results using the SPACE code are compared with those from the experiment.

2. ATLAS SGTR Experiment

2.1 Description of ATLAS Test Facility

The ATLAS (Advanced Thermal-Hydraulic Test Loop for Accident Simulation) is a thermal-hydraulic integral test facility for advanced pressurized water reactors. It is located within Korea Atomic Energy Research Institute (KAERI).

The reference plant of the ATLAS is a 1400 MWe-class evolutionary pressurized water reactor (PWR), APR1400 (Advanced Power Reactor 1400 MWe), which was developed by the Korean nuclear industry. The ATLAS also incorporates some specific design characteristics of a 1000 MWe-class Korean standard nuclear power plant, OPR1000 (Optimized Power Reactor 1000 MWe), such as the cold leg injection (CLI) mode of the safety injection and low pressure safety injection pumps.

The ATLAS facility has the following characteristics: (a) 1/2-height and length, 1/288-volume, and full pressure simulation of APR1400, (b) maintaining a geometrical similarity with APR1400 including 2 (hot legs) and 4 (cold legs) reactor coolant loops, direct vessel injection (DVI) of emergency core cooling water, integrated annular downcomer, (c) incorporation of specific design characteristics of OPR1000 such as cold leg injection and low-pressure safety injection pumps, (d) maximum 10% of the scaled nominal core power. The ATLAS can simulate broad scenarios of design-basis accidents (DBAs) including the reflood phase of a large-break loss-of-coolant accident (LBLOCA), small-break LOCA (SBLOCA) scenarios including DVI line breaks, steam generator tube rupture, main steam line break, feed line break, mid-loop operation, etc.

2.2 Description of Steam Generator Tube Rupture Experiment

The SGTR accident is one of the design basis accidents having a significant impact on safety in a viewpoint of radiological release. In this study, a postulated SGTR event of the APR1400 was experimentally investigated with the ATLAS. As one of the most limiting SGTR accidents, a break flow equivalent to a double-ended rupture of a single U-tube was simulated in the present SGTR-HL-04 test. The break tube has an orifice with inner diameter of 1.68mm. The broken U-tube in the experiment was modeled as shown in Fig.1. The initial conditions for the experiment are shown in Table 1.

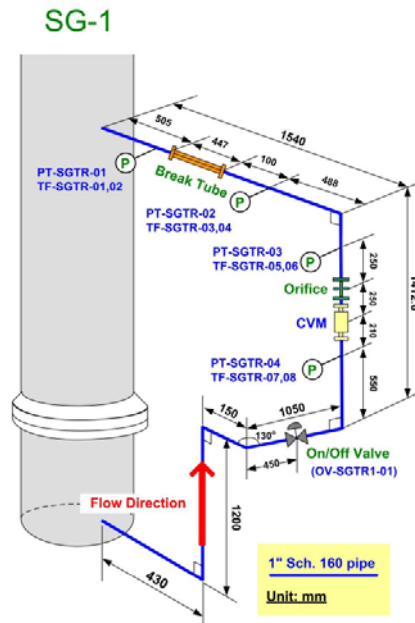


Fig. 1. Broken U-tube section for the ATLAS SGTR

Table 1. Initial conditions for ATLAS SGTR-HL-04

Description	Initial value
Nominal Power (MWt)	1.631
Pressurizer pressure (MPa)	15.39
Cold leg temperature (°C)	291.9
Hot leg temperature (°C)	325.1
Cold leg flow rate (kg/s)	2.24
Steam pressure (MPa)	7.83
Steam flow rate (kg/s)	0.397

3. SPACE Calculation

3.1 General Description of the SPACE Code

The SPACE code is an advanced thermal hydraulic analysis code capable of two-fluid, three-field analysis. The SPACE code can be used in LBLOCA, SBLOCA and in Non-LOCA analysis of PWRs.

3.2 SPACE Nodalization

The SPACE nodalization of the ATLAS experiment facility is shown in figure 2. Two hot legs, four cold legs, two steam generators are modeled. The core power is taken from the experiment results and entered using table. The break flow is calculated using Ransom-Trapp choking model. The heat loss to the environment is modeled using heat structures.

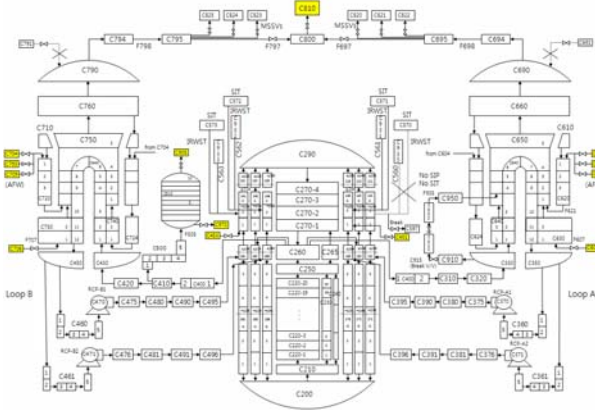


Fig. 2. SPACE nodalization for ATLAS SGTR

3.3 Calculation Results

The transient scenario was calculated with the SPACE code and the results were compared with measured results. Before the transient calculation, a 2000sec steady state calculation was performed to stabilize all variables to the initial condition of the experiment. The transient calculated was restarted at t=0sec, and the actual tube break occurred at t=206 sec. The major sequence of events for SGTR-HL-04 is shown in table 2.

Table 2. Major sequence of events

Event	Time [sec]
Break opening	206
Main feedwater isolation	291
Main steam line isolation	291
Low pressurizer pressure	1267
Safety injection start	1295

Fig. 3 shows break flow rate through the break tube. The break valve opens at t=206sec. The SPACE code slightly under-predicts initial break flow rate, but shows

good agreement with experiment results after initial peak break flow. Fig.4 shows accumulated break flow through the broken tube. The SPACE code results show good agreement with the experiment.

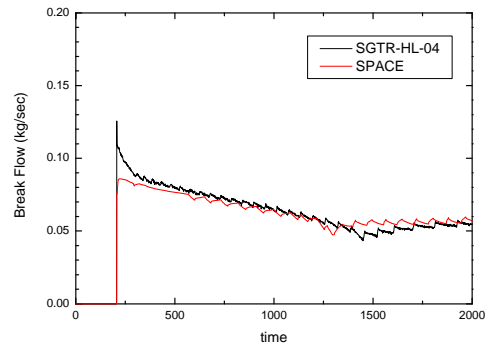


Fig. 3. Break flow rate at broken U-tube

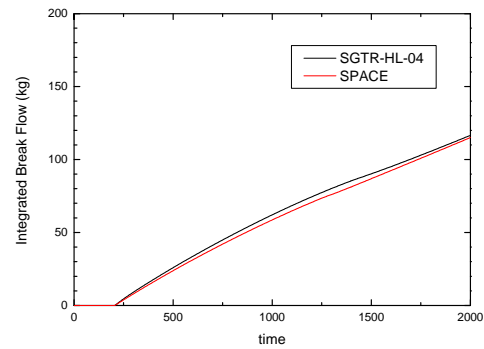


Fig. 4. Accumulated break flow

4. Conclusions

The ATLAS SGTR-HL-04 experiment, which is a single U-tube rupture test, was simulated using the SPACE code. The calculated results were compared with those from the experiment. The comparisons of break flow rate and accumulated break flow mass show good agreement with the experiment. The SPACE code is capable of predicting physical phenomena occurring during ATLAS SGTR-HL-04 experiment.

REFERENCES

- [1] K. Y. Choi, Quick Look Report on the Steam Generator Tube Rupture Test(SGTR-HL-04) with the ATLAS, KAERI, 2011.
- [2] Sang Jun Ha, et al. Development of the SPACE Code for Nuclear Power Plants, Nuclear Engineering and Technology, Vol.43 No.1 pp45-62
- [3] SPACE Users Manual, KHNP, 2012