

## Experimental Investigation on Injection Performance of Two-Type CMT with Different Diameter and Same Volume during SBLOCA Test

Hwang Bae<sup>a\*</sup>, Sung Uk Ryu<sup>a</sup>, Byong-Guk Jeon, Sun-Jun Byun, Hyo Bong Ryu<sup>a</sup>, Yong-Cheol Shin<sup>a</sup>, Kyoung-Ho Min<sup>a</sup>, Jong-Kuk Park<sup>a</sup>, Nam-Hyun Choi, Yun-Gon Bang<sup>a</sup>, Sung-Jae Yi<sup>a</sup>, Hyun-Sik Park<sup>a</sup>

<sup>a</sup>Korea Atomic Energy Research Institute, 989-111 Daedeokdaero, Yuseong, Daejeon, 305-353, Korea

\*Corresponding author: hbae@kaeri.re.kr

### 1. Introduction

The Korea Atomic Energy Research Institute (KAERI) has conducted a study on passive safety system (PSS) to improve the safety of SMART[1], which maintains the reactor in a safe condition during the design basis accident without any AC power to drive the safety injection pumps and operator action with no more than 72 hours. For verification of this SMART PSS, a single train of a passive safety system consisting of a core makeup tank (CMT), a safety injection tank (SIT) and two stages of an automatic depressurization system (ADS) were attached additionally to the existing SMART-ITL facility.

Two CMTs with different lengths while having the same volume were installed. CMT # 1-1 and CMT #1-2 have the same volume. The vertical length of the CMT #1-2 is one-half of the CMT #1-1. They have different header diameters. To evaluate the effects of the header diameter of CMT, several tests using the CMT #1-1 and #1-2 with different-type flow distributors were carried out under the same procedure and conditions, respectively. The A and C-type Flow distributors were installed in the upper part of each CMT.

This paper describes the test procedure and test result of an SBLOCA simulation to evaluate the CMT injection performance of a passive safety system. The initial condition of the test is the same as the steady-state operating conditions. The test was carried out according to the sequence of events (SOE) for an SBLOCA scenario. Four tests results are discussed. In particular, the temperature change in the upper header of each CMT with each flow distributor and the injection behavior occurring in the early stage of the transient test was investigated.

Most of the thermal-hydraulic properties such as the pressure, temperature, flow rate, and water level showed partially transient phenomenon with the operation of the passive safety system, but the injection characteristics of the CMT showed good and stable behavior from a macro perspective. In this paper, only the results of S109, which were similar to the results of S108 qualitatively and quantitatively, are presented.

### 2. Methods and Results

#### 2.1 Overview of SMART-ITL

SMART is a 330 MW thermal power reactor, and its core exit temperature and PZR pressure are 323 °C and 15 MPa during normal working conditions, respectively. The maximum power of the core heater in SMART-ITL (Fig. 1) is 30% for the ratio of the volume scale. The reactor coolant system of SMART-ITL [3,4] was designed to operate under the same conditions as SMART [5].

The reactor coolant pump (RCP) was designed geometrically by the volume scale law, which was applied to the diameter of suction and discharge, and the liquid volume. The scale ratio of the flow rate was in proportion to the related power ratio of the core heater. Four reactor coolant pumps were installed in the upper annulus side of the pressure vessel at an angle of 90 °.

Four once-through steam generators with a helical coil were installed at the same azimuth as the RCP outside the reactor pressure vessel of SMART-ITL. The steam generator consists of primary and secondary sides. The primary function of the SG is to remove the heat of the RCS. The heat of the primary side is transferred to the secondary side in the steam generator, while the hot reactor coolant is floating through the cell side and the feed water is traveling through the tube side. To simulate the characteristics of the heat transfer, it was designed such that the surface area of the tube was properly scaled down with the scale ratio.

The secondary system consists of a feed water supply system, steam supply system, and condensation and cooling system. It is important to supply the feed water with a constant temperature and to generate the superheated steam as the boundary values.

The passive residual heat removal system (PRHRS) plays a role in removing the residual heat of the core when an accident that decreases the pressure of the RCS, for example an SBLOCA, occurs. It has four trains. Each train has an emergency coolant tank and heat exchanger for the condensation of the steam. One makeup tank per train was installed for the pressure compensation. Individual components were scaled down by the volume scale ratio, and the pipes were designed for conserving the similarity of the pressure drop.

#### 2.2 Passive Safety System

The passive safety system includes the core makeup tank (CMT) and safety injection tank (SIT). Individual

tanks are connected with the pressure-balanced pipes on the top side and injection pipes on the bottom side. This system is operated when a small break loss of coolant accident (SBLOCA) or steam line break (SLB) occurs. There are no active pumps on the pipe lines to supply the coolant. This system is only actuated by the gravity force caused by the height difference because all tanks are higher than the injection nozzle around the reactor coolant pumps (RCP).

Fig. 2 shows schematics of one train for the passive safety system of SMART-ITL. Each pipe has an isolation valve and flow meter. The differential pressure and temperature can be measured for every pipe and tank. A level and pressure transmitter is installed in each tank.

The phenomena of flashing and direct contact condensation are expected to occur in the CMT, SIT, and pipes at the early stage. Appropriate thermocouples have to be installed in the pipes and tanks to investigate the complex thermal-hydraulic phenomena after the system is operated by opening the isolation valve.

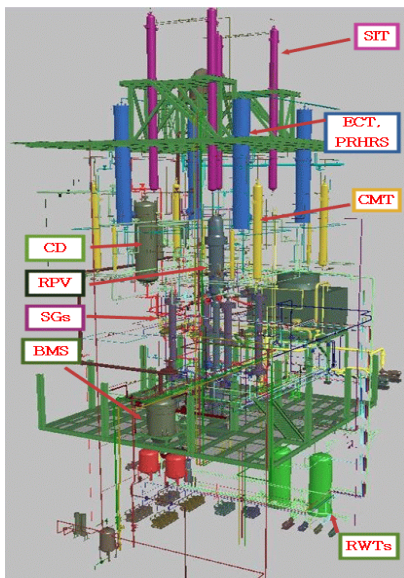


Fig. 1. Schematics of the SMART-ITL.

### 2.3 Scaling Methodology

CMT and SIT are designed based on the volume scale law of 1/49. Their heights are conserved. The diameter is scaled down to 1/7, and the area of the tank cross-section is scaled to 1/49. The primary scale variables are listed in table I.

To maintain the characteristics of the pressure drop in the pipes between a proto-plant and a facility, a local-phenomena scaling method was applied. The local scale variables are listed in Table II. First, a scale factor,  $k$ , for the diameter to satisfy the volume ratio of the pipes was assumed. A length ratio was derived by substituting the factor into the volume scale ratio. Using these two ratios, a temporary  $k_1$  can be selected to satisfy the Friction Number and Orifice Number. Second, another  $k_2$  was selected to satisfy the ratio of

the pressure drop, flow rate, and so on. Finally, through the best estimation, a specific  $k$  was determined to avoid the distortion of the real phenomena.

Table I: Primary scale variables

Parameters	Scale Ratio	Value
Length, $l_{OR}$	$l_{OR}$	1/1
Diameter, $d_{OR}$	$d_{OR}$	1/7
Area, $a_{OR}$	$d_{OR}^2$	1/49
Volume, $V_{OR}$	$d_{OR}^2 l_{OR}$	1/49
Time scale	$l_{OR}^{1/2}$	1/1
Velocity	$l_{OR}^{1/2}$	1/1
Flow rate	$a_{OR} l_{OR}^{1/2}$	1/49
Pressure drop	$l_{OR}$	1/1

Table II: Local scale variables

Parameters	Scale Ratio	Value
Length, $l_L$	$l_L$	$V_{OR} / k^2$
Diameter, $d_L$	$d_L$	$k$
Area, $a_L$	$d_L^2$	$k^2$
Volume, $V_L$	$V_L$	$V_{OR}$
Time scale	$l_L^{1/2}$	$(V_{OR})^{1/2} / k$
Velocity	$l_L^{1/2}$	$(V_{OR})^{1/2} / k$
Flow rate	$a_{OR} l_{OR}^{1/2}$	$k * (V_{OR})^{1/2}$
Pressure drop	$l_L$	$V_{OR} / k^2$

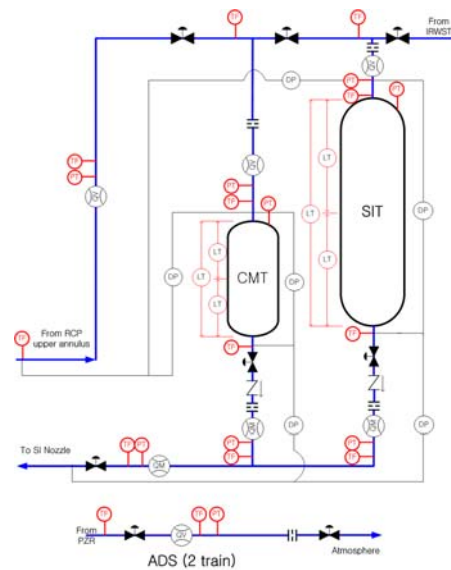


Fig. 2 Schematics of the test facility for SMART passive safety system

### 2.4 Cold State Tests: Flow Resistance Coefficient in Injection Line

The flow rate under gravity injection conditions depends on the differential pressure in the injection line. By adjusting the orifice size, the differential pressure can be controlled. Differential pressure tests were conducted to determine the orifice size in the injection line of a core makeup tank (CMT). The tests were

carried out in two steps for two different CMTs, which were a full-height CMT of #1-1 with a 1/49 volume compared with SMART, and a half-height CMT of #1-2 with the same scaled volume. As the first step, a basic differential pressure was measured without each orifice. The diameter of the orifice was determined based on the estimation of the flow resistance coefficient to satisfy the design value in the injection line. As the second step, the differential pressure through the orifice was measured. Injection flow rate curves for the CMTs with two different heights are well matched for the slope and end time of the injection.

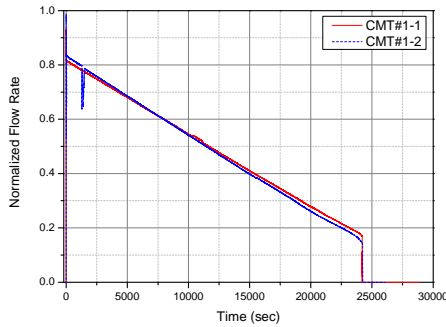


Fig. 3. Injection flow rate of 1-train CMT.

Parameter	Normalized state-state condition			
	(Measurement / Target value, %)			
Test Case	C1A	C2A	C1C	C2C
Power	111	111	110	109
PZR pressure	100	100	100	100
1 <sup>st</sup> flowrate	104	103	101	100
SG 1 <sup>st</sup> inlet temperature	100	100	100	100
SG 1 <sup>st</sup> outlet temperature	101	101	101	101
Feed Water. flow rate	100	100	100	101
SG 2 <sup>nd</sup> outlet Pressure	100	100	100	100

Table III: Description of the steady-state condition

Table IV: Major Sequence of the SBLOCA

Event	Trip signal and Set-point
Break	-
LPP set-point	PZR Press = $P_{LPP}$
LPP reactor trip signal	
- Pump coastdown	LPP+1.1 s
- CMTAS triggering	
Control rod insert	LPP+1.6 s
CMT injection start	LPP+2.2 s
FW stop	
FIV/MSIV close	LPP+25.2 s
Test end	-

## 2.5 Steady State Condition

Steady-state conditions were applied to satisfy the initial test conditions presented in the test requirement, and its boundary conditions were properly simulated.

A steady-state operation of four tests was maintained over 600 seconds prior to the transient test. Table III shows the normalized-major parameters of the target values and test results during the steady-state conditions. The mean of the test case is indicated in the Table IV

Table IV: Test ID

Test Case	CMT	Flow Distributor
C1A	#1-1	A
C2A	#1-2	A
C1C	#1-1	C
C2C	#1-2	C

## 2.6 SBLOCA Simulation of SI Break

A Safety Injection System (SIS) is an important part of a nuclear reactor system during a loss-of-coolant accident. SI lines are connected to the reactor vessel and the makeup water is supplied to itself during the loss-of-coolant accident. During this test, the SBLOCA with a SI line break was simulated.

The break type is a guillotine break, and its break location is on the SI line (nozzle part of the RCP discharge). The thermal-hydraulic behavior happens at the same time in the SMART-ITL and SMART designs according to the time scale ratio. The scaled-down break nozzle diameter is 7.26 mm in the SMART-ITL.

The pressure behavior of the primary side is a representative boundary condition because the system trip signal is actuated by the specific pressure value. An SBLOCA test on the SI line break was carried out according to the sequence of events as follows. The steady-state conditions (constant high pressure and temperature) → break (pressure, temperature, and water level decrease) → LPP → RCP coast down, heater trip (no residual heat decay curve) → isolation of the feedwater and steam lines, feedwater stop → CMT actuation. The CMT actuation signal was generated. In each test, PRHRS, SIT, and ADS did not actuate in each test.

The constant high pressure and temperature of the primary system under a steady state decreases rapidly after the break starts, as shown in Fig. 3. An individual actuation signal such as the RCP coast down, heater trip, PRHRS, CMT worked after the pressure reached a specific value, LPP. The system was cooled down by the safety system from that time. Fig. 3 shows that the decreasing behavior of primary pressure. This means that the pressure vessel cooled down efficiently with the operation of the CMT. Fig. 4 shows the equivalent collapsed level of the reactor vessel during transient test. The behavior of the pressure and collapsed level for

four tests is consistent with each other. It shows that the each test was performed in robust boundary conditions.

### 2.7 Injection Characteristics

Left column of Fig. 5 shows the comparison of the upper-part temperature and CMT level. The CMT level is began to suddenly decrease after temperature near the flow distributor installed in the in the CMT center of the upper header is increased for all of tests.

Right column of Fig. 5 shows the comparison of the upper-part temperature and injection flow rate. The injection flow rate is began to increase at the same time to the sudden decrease of the CMT level.

After opening an isolation valve located on the injection line of the CMT, the injection of the core makeup water began. In this initial stage of the CMT injection, steam from the primary system was mixed with the relatively cold coolant at the upper header of the CMT, and thus direct condensation was expected to occur. The initial injection flow rate showed unstable behavior while repeatedly increasing and decreasing.

High-temperature steam from reactor vessel makes the cold water and surface of the CMT high during the direct condensation. The injection flow rate shows the stable behavior after the upper part of the CMT has an equivalent temperature to the steam of the reactor vessel.

## 3. Conclusions

An SBLOCA test on the SI line break was conducted to evaluate the injection performance between the CMT #1-1 and #1-2 with different flow distributors of an integral small reactor. The steady state required by the procedure as the initial condition was well maintained. The actuating sequences required by the boundary condition operated on time as well.

- During the initial stage of the SI break simulation, the primary pressure was decreased rapidly and the water of the CMT was injected well.
- During the initial stage of CMT injection, an unstable injection phenomenon was observed because of a direct condensation of steam with high temperature and pressure.
- An interactive behavior among the temperature, level, and flow rate of the CMT was observed as well. The direct condensation of the upper head in the CMT takes an important role of stable injection.

In the near future, a test facility will be equipped with a 4-train passive safety system with a CMT and SIT per train. The co-authors have a plan to carry out new sets of tests using a 4-train passive safety system.

## ACKNOWLEDGEMENT

This work was supported by the National Research Foundation of Korea (NRF) grant funded by the Korea government (MEST) (No. 2013M2B9A1020039)

## REFERENCES

- [1] Y. M. Bae, Report of Passive Safety System, SER-410-FS403-SD, 2012.
- [2] H. Bae, S. U. Ryu, H. B. Ryu, W. S. Kim, S. J. Lee, and H. S. Park, An Experimental Investigation on thermal-hydraulic Interaction between Core Makeup Tank and Safety Injection Tank of an Integral Small Reactor during a Small Break Loss-of-Coolant Accident, Proceedings of the ASME-JSME-KSME Joint Fluids Engineering Conference 2015, July 26-31, 2015, SEOUL, KOREA (Submitted)
- [3] H. S. Park, S. J. Yi, and C. H. Song, SMR Accident Simulation in Experimental Test Loop, Nuclear Engineering International, November 2013, 12-15.
- [4] H. Bae, D. E. Kim, S. J. Yi, and H. S. Park, Test Facility Design for the Validation of SMART Passive Safety System". Transactions of the Korean Nuclear Society Spring Meeting, Gwangju, Korea, May 2013. pp.30-31.
- [5] K. K. Kim, et al., SMART: The First Licensed Advanced Integral Reactor, Journal of Energy and Power Engineering, 8, 94-102, 2014..

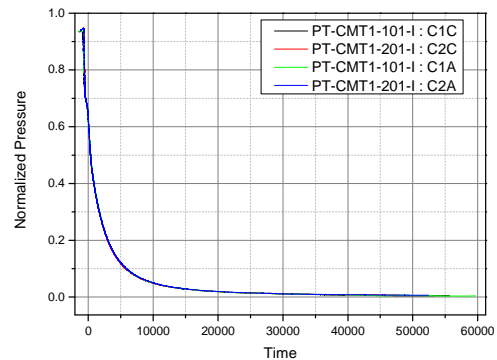


Fig. 4 Pressure of CMT

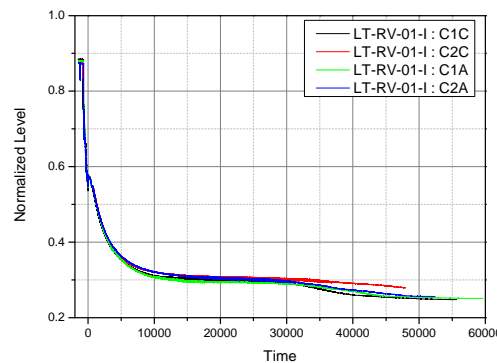


Fig. 5 Level of Reactor Coolant System

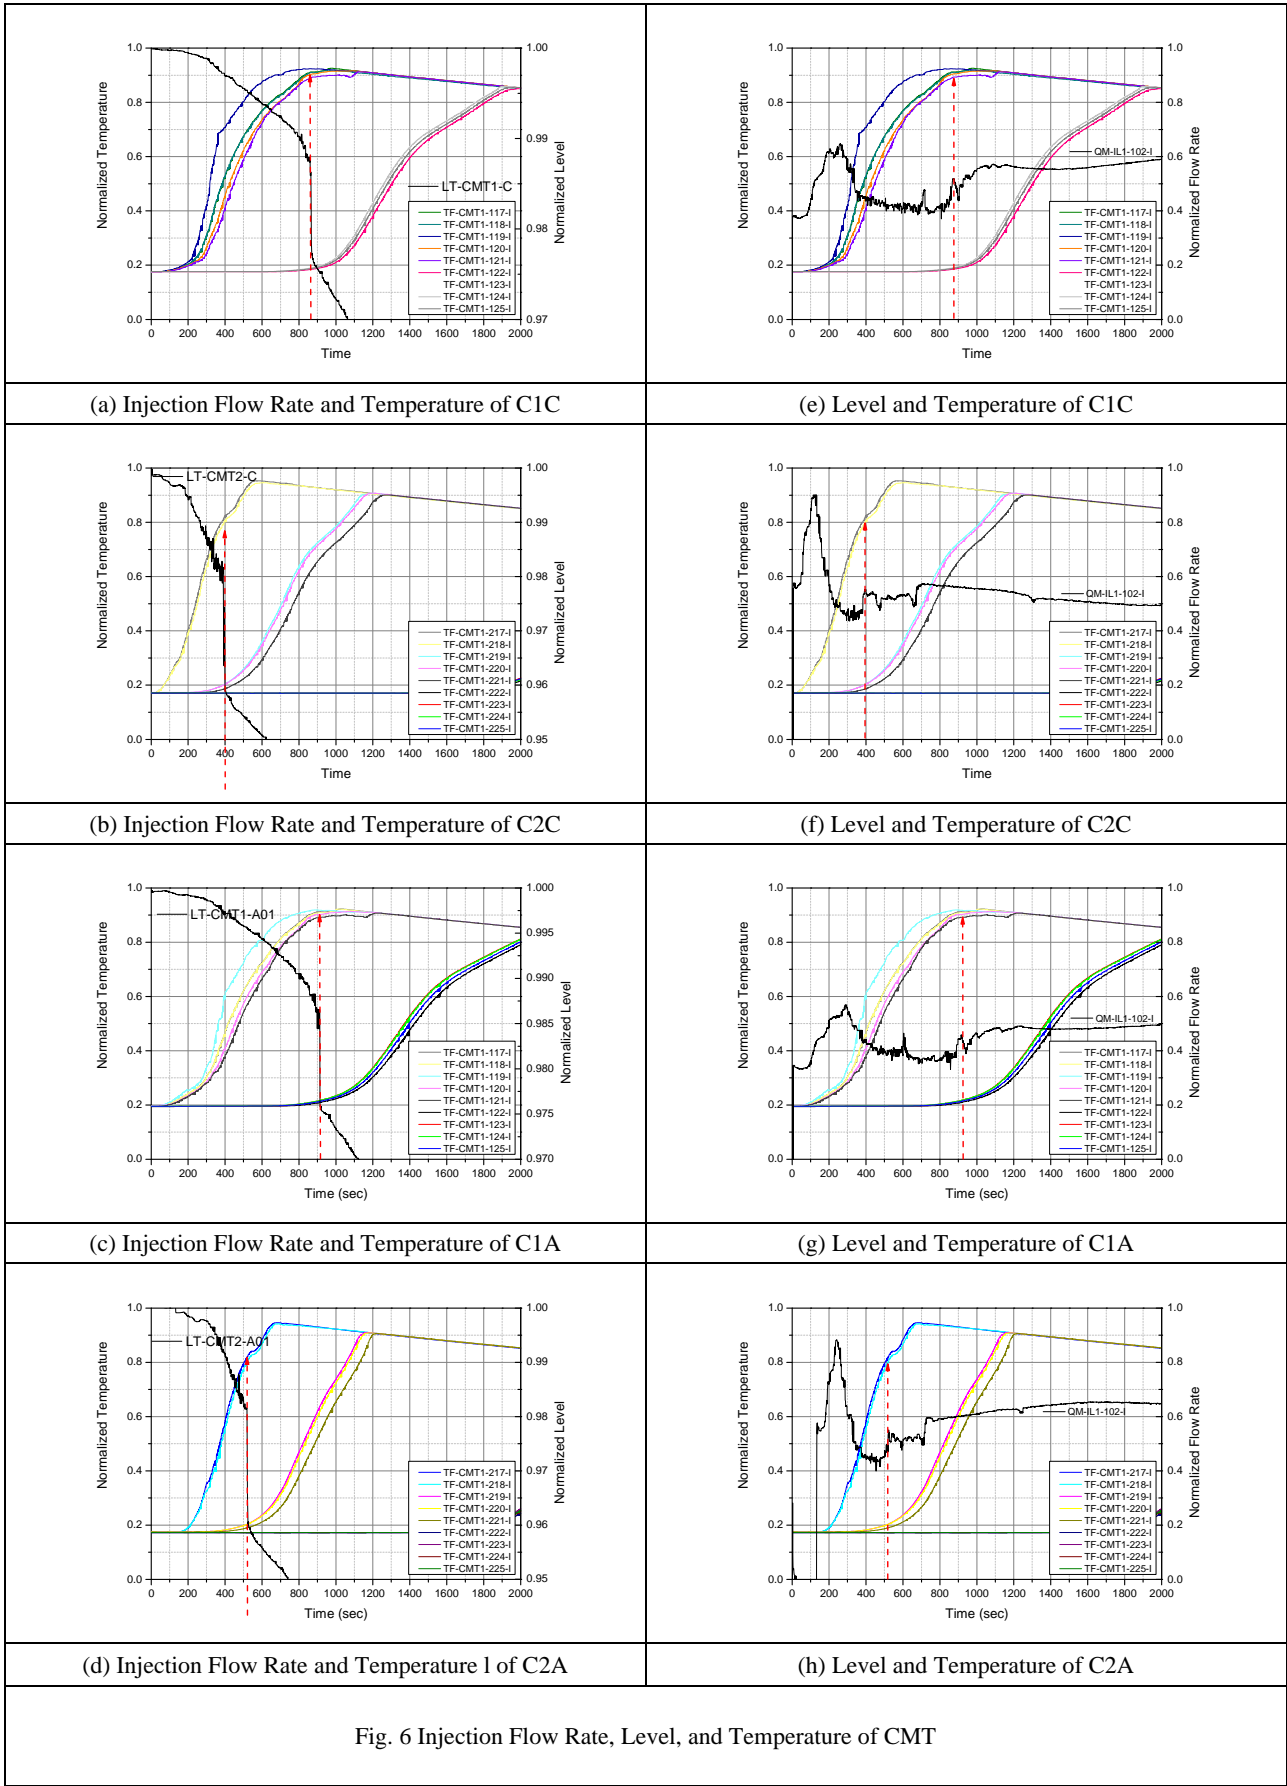


Fig. 6 Injection Flow Rate, Level, and Temperature of CMT