

*Korean Nuclear Society Spring Meeting
Jeju, Korea, May 13-14, 2021, On-line Upload*

For Improvement of Hydrogen Mitigation Actions' Effect



Seong-Wan HONG(KAERI),
Sanjeev GUPTA(BT), Jongtae KIM(KAERI)
swhong@kaeri.re.kr

Table of Contents

- Introduction
- Methods and Results
 - Hydrogen mitigation in SAMG
 - On improvement of hydrogen mitigation effect
- Conclusions



Introduction

- The Fukushima Daiichi accident : the importance of the study on hydrogen mitigation has been further stressed.
- Most of experimental works : focused on clarifying the separate phenomenology related to the containment thermal hydraulics and the separate-effect performance tests of hydrogen mitigation systems
- The SAMG (Severe Accident Management Guidelines) is a very important tool to mitigate the accidents.
- Topics for improvement of the effects of hydrogen mitigation actions in SAMG are proposed by reviewing the means and the uncertainties for hydrogen mitigation in SAMG.



Hydrogen mitigation in SAMG

- Two guidelines for hydrogen mitigation of the W/H SAMG for PWR which are derived from the EPRI general SAMG.
- SAG-7 : Reduce containment hydrogen
 - Objective : Removal of risk by hydrogen combustion in the containment
 - Action and Means :
 - Hydrogen combustion : Ignitors or Intentional hydrogen combustion(Electrical spark by generator)
 - Hydrogen removal : PARs
 - Uncertainties
 - PARs
 - Whether the hydrogen in the containment can be removed sufficiently by a PAR without adverse effects
 - Possibility of self-induced ignition source by a PAR
 - Prevention or hindrance of the recombination of hydrogen and oxygen by steam
 - Performance under the high concentration of airborne aerosols.
 - Ignitors
 - Information of the hydrogen concentration in the containment
 - Measurements of hydrogen concentration in the containment atmosphere.

KAERI

한국원자력연구원
Korea Atomic Energy Research Institute


Hydrogen mitigation in SAMG

- SCG-3 Control Hydrogen Flammability
- The guideline is firstly taken than SAG-7 if the criteria of SCG-3 is satisfied.
- The criteria is the hydrogen concentration of region that may happen detonation from the calculation aid. This means that hydrogen concentration is in the range that does not allow hydrogen combustion.
- The objective
 - Prevent hydrogen combustion by maintaining steam-inerting.
- The action
 - Keep steam-inerting by stopping operation of heat sinks and/or opening of Reactor Cooling System (RCS) valve.
 - Isolate potential ignition source of non-safety valve or venting the containment.
- Uncertainties of steam-inerting
 - Operation of containment heat removal system such as containment spray and fan cooler.
 - Mass of hydrogen and hydrogen distribution throughout containment compartments.




Hydrogen mitigation in SAMG

- The implementation procedure of hydrogen mitigation systems : different depending on the plant as HMS are different.
- CA : Calculation Aids
 - Typical example and plant specific
 - TSC Uses CA to copy with accident.

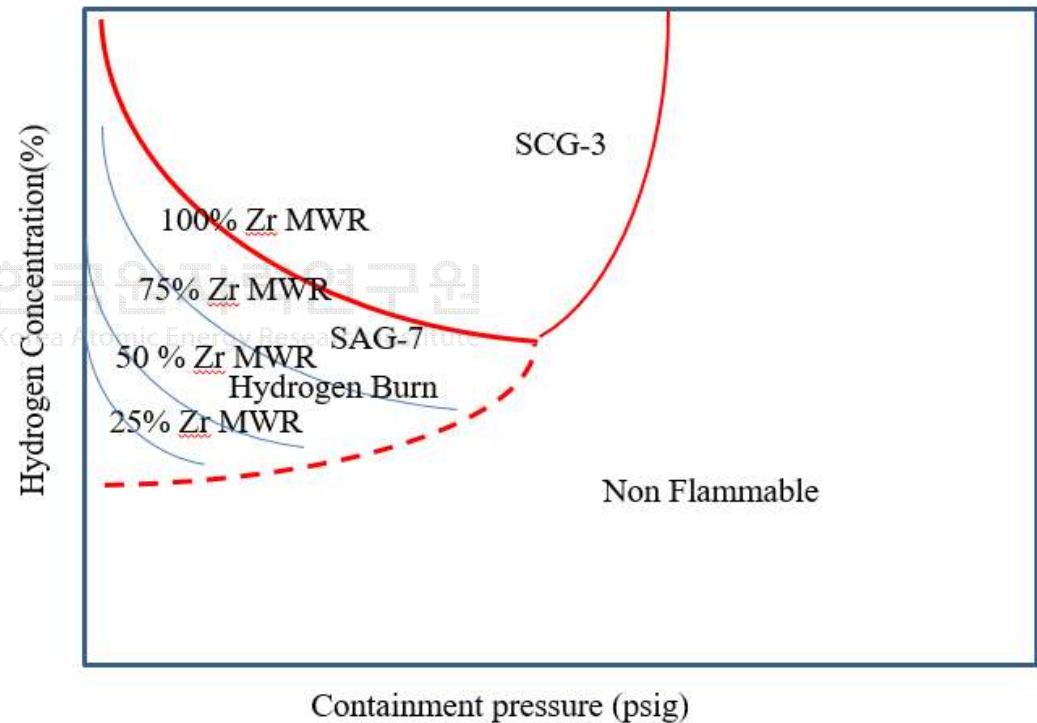


Hydrogen mitigation in SAMG

- Implementation Procedure for Hydrogen Mitigation of Plant with PAR
- There exists the possibility to take SAG-7 or SCG-3, in the case the hydrogen is not sufficiently removed by PAR.
- If the information from the hydrogen concentration measurement is not available, the calculation aid will be used to decide the hydrogen concentration using the containment pressure and the oxidation of Zirconium, and then operator will take one guideline of SAG-7 or SCG-3
- If the hydrogen measurement is available from hydrogen measurement systems, one of SAG-7 or SCG-3 depending on the hydrogen concentration will be taken
- If the ignition is allowed, the hydrogen will be consumed by generating sparks by using all available means (SAG-7).
- If the ignition is not allowed, the action (SCG-3) which will not induce combustion will be taken.

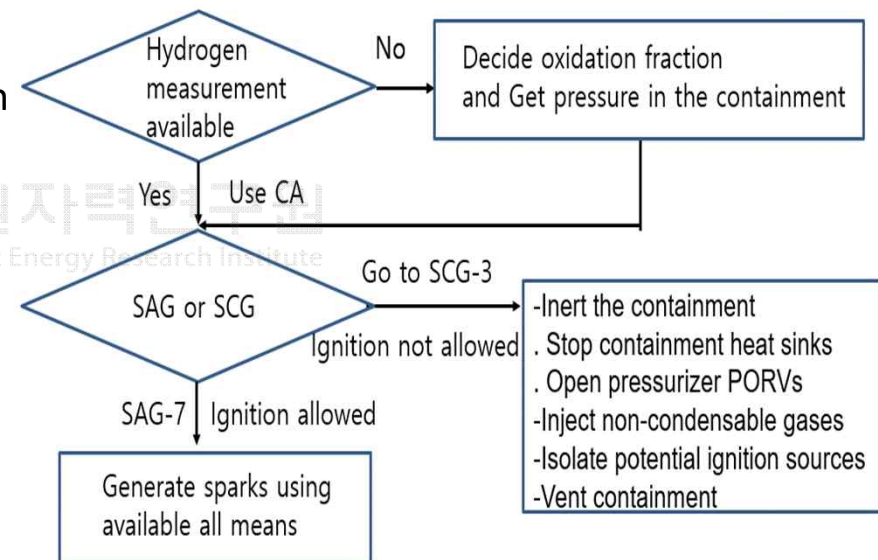

Hydrogen mitigation in SAMG

- Implementation Procedure for Hydrogen Mitigation of Plant with Igniters
- If the ignition is allowed, the ignition will be used to consume hydrogen either with an igniter or by using other available means because other than combustion there is no means to consume the hydrogen in the containment.
- It is highly possible to take one SAG-7 or SCG-3 at least.
- The implementation procedure of the plant adapting PARs and igniters (“dual concept”)
- The same as adaption of igniters because PARs don't need operator action for the operation.
- But, this combination of two systems will make the lower possibility to take SAG-7 or SCG-3 in the accident.

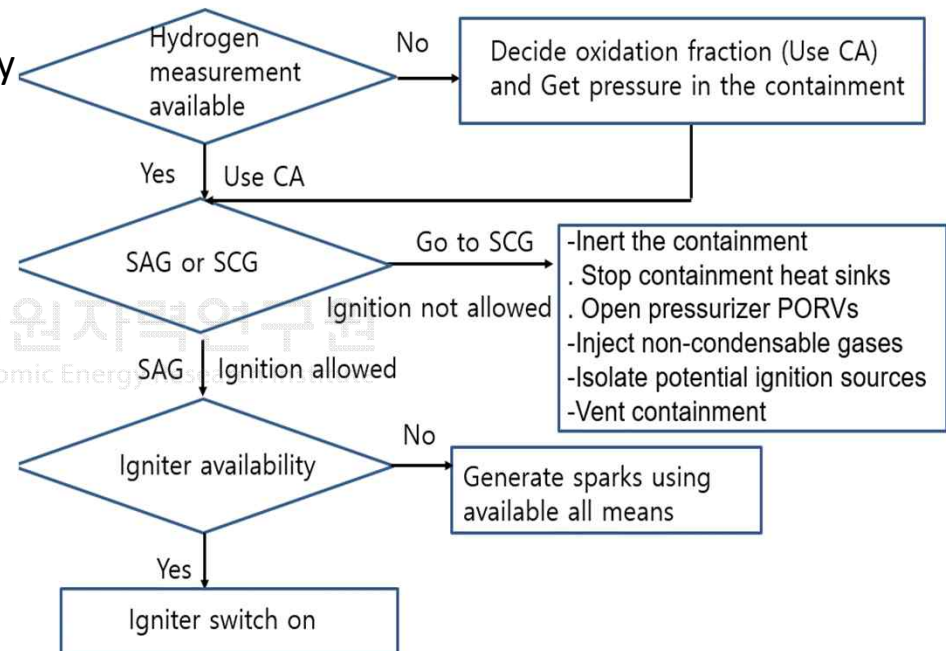

On improvement of hydrogen mitigation effect

- PAR is one of major means for hydrogen control in the containment without operation action.
- The operation of Engineering Safety Features (ESFs), such as spray is inevitable to induce the low pressure of the containment
- There are several merits to run spray in accidents if hydrogen threat were removed. Accordingly, it is highly required by SAMG to spray the containment in order to decrease the amount of airborne radioactive aerosols and gases in the containment.
 - The working of spray will greatly contribute to reduce airborne aerosols in the containment and considerably mitigate the release of fission products even if there happens containment failure.
 - Another advantage in the use of spray is that the operation of spray induces a mixing in the whole containment. It can break stratifications of the hydrogen. If there were some small hydrogen clusters, they can also break-p thanks to the mixing induced by this measure.

On improvement of hydrogen mitigation effect

- It is known that only few experimental data at low hydrogen concentration in a small scale on the performance of PAR with spray is available
- But, data on hydrogen concentration change and ignition potential at a little high hydrogen concentration under the PAR operation with spray are not available.
- Ignition potential of PAR
 - one of major adverse effect for hydrogen control because it causes the unintended combustion.
 - The other insistence is that the ignition potential may be merit for hydrogen control because hydrogen can be consumed [5]. To be manifest is that the ignition potential of PAR is still on the discussion in the world.
 - Meanwhile, the important result was recently found that PAR ignition potential is limited to a relatively small area of mixture compositions in the air-hydrogen ternary diagram.
- However, at this moment, there is no way to prevent such PAR from self-actuating or to shut PAR off in elevated hydrogen concentrations.



On improvement of hydrogen mitigation effect

- Accordingly, it is recommended to further investigate PAR operation under ESFs operation because the hydrogen concentration under ESFs may reach the ignition potential region.
- In addition, the effect of the ignition potential of PAR under operation of heat removal systems is the same with the effect of igniter operation under operation of heat removal systems.
- It is also necessary to consider PAR induced ignition behaviour in containment safety analyses for hydrogen control by using computer codes. This analysis has to include 3-dimensional analysis to see the possibility of DDT considering containment geometry and the PAR location.



On improvement of hydrogen mitigation effect

- If the ignition potential by PARs can be excluded, the negative effects of ignition potential accompanied with the operation of engineered safety systems will be removed and the operator is free to use the engineered safety systems without a fear of unintentional combustion.
- Then, the guidelines to be taken in severe accident can be very simplified because operator don't need to consider the negative effects caused by operation of ESFs.
- Accordingly, it is important to develop the PAR without malfunctioning of ignition potential.



On improvement of hydrogen mitigation effect

- There have been some efforts to develop PARs without ignition potential. However, the pros and cons shall need to be considered of such development work considering H₂ combustion at elevated concentration (> 8 vol. %) may occur by random ignition sources available in containment.
- Nevertheless, it is important to assess PAR performance under a broad spectrum of accident scenarios, e.g, interaction with airborne fission products, late phase MCCI conditions (e.g. CO presence) and under different oxidation potential (or rich or O₂ lean conditions).
- The assessment is necessary to ensure that the PAR recombination capacity remains in agreement with its design values as considered during their installation mythology, e.g. number of PARs.



Conclusions

- From reviewing the hydrogen mitigation actions in SAMG, it is recommended to study on PAR operation under ESFs operation including experiments.
- In addition, ignition potential of PAR has to be included in plant safety analysis.
- It is also necessary to assess PAR performance under a broad spectrum of accident scenarios to ensure that PAR installation methodology, such as number of PARs, remains optimal for the entire course of an severe accident.

